



# DRAFT DEV01

REV	REV DATE	DESCRIPTION	APPROVAL
A	2020-09-09	INITIAL REVIEW	SD/RF


Notes/Instructions:

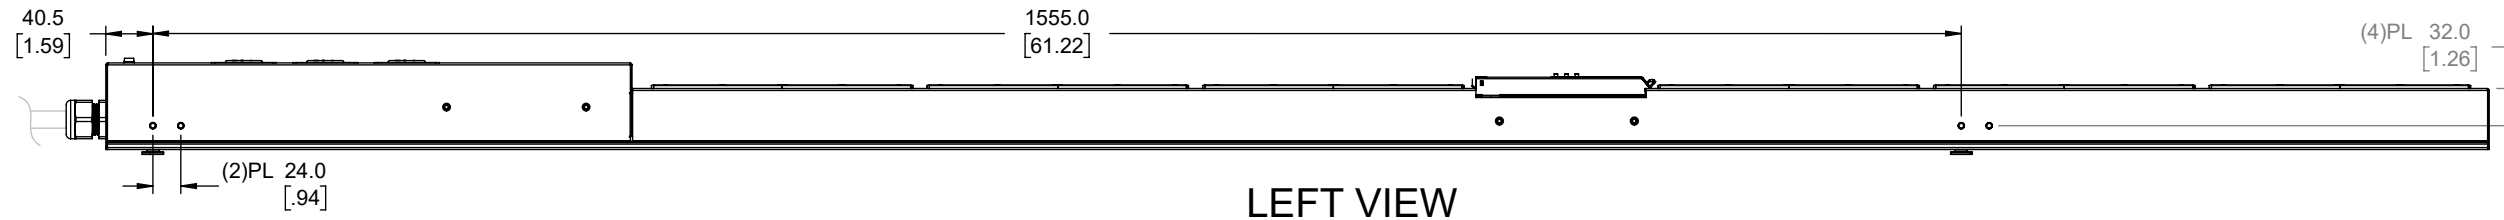


**LEFT VIEW**

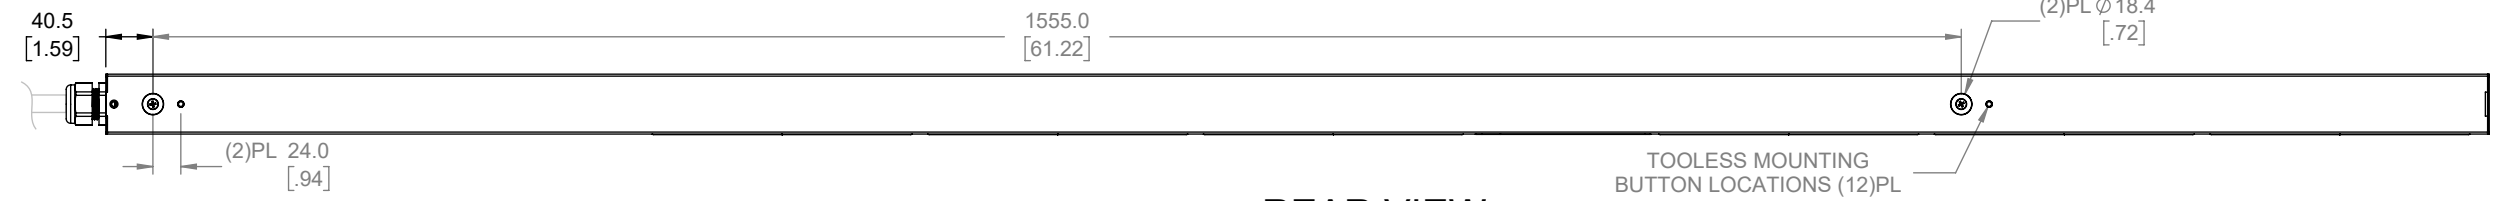


**REAR VIEW**

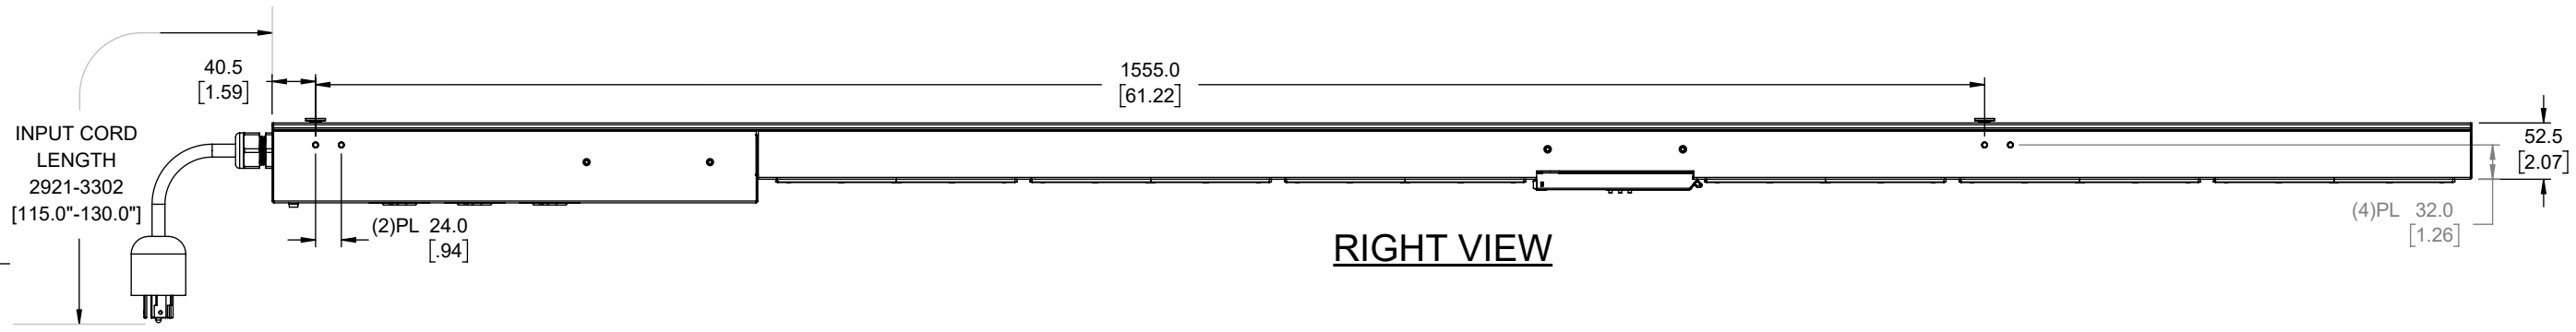

**RIGHT VIEW**

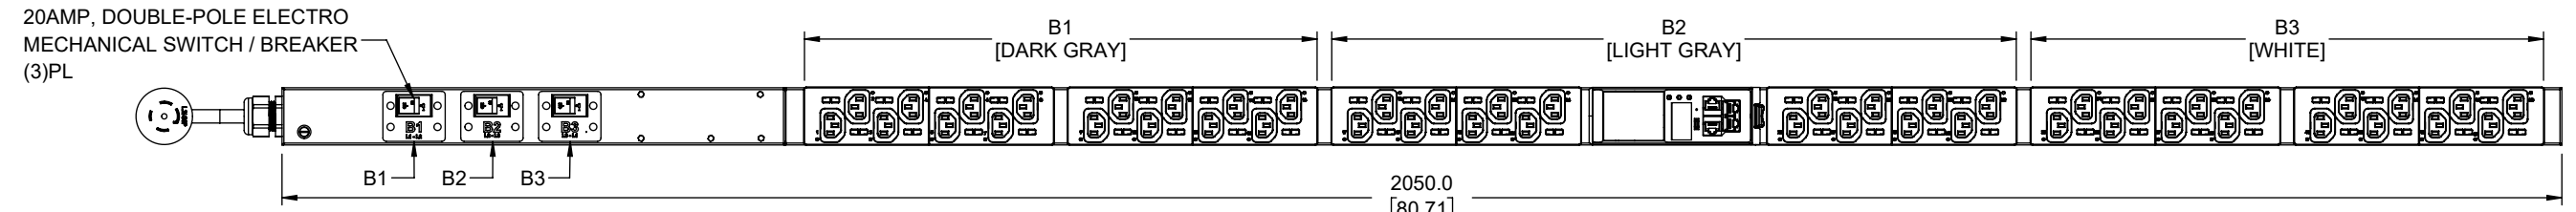

**FRONT VIEW**



**BOTTOM VIEW**

**PLUG/RECEPTACLE BLOCK**

**PLUG**  
NEMA L21-30P, 4P 5W  
30A, 120/208V, MAX RATED INPUT  
(24A DERATED)

**RECEPTACLES**  
IEC 60320/C19  
16A, 250V MAX RATED OUTPUT

**RECEPTACLES**  
IEC 60320/C13  
10A, 250V MAX RATED OUTPUT

**SPECIFICATIONS:**

UNIT TYPE:	MONITORED INPUT, SWITCHED
ORIENTATION:	VERTICAL, 0U FULL
OUTLET QTY & TYPE:	(48)C13
INPUT VOLTAGE:	208VAC
INPUT CURRENT:	30A (24A DERATED)
BREAKER QTY & TYPE:	(3) 20AMP, DOUBLE-POLE
INPUT PHASE:	THREE-PHASE (DELTA)
RATED POWER:	8.65kVA
INPUT PLUG:	3P+N+E
INPUT POWER CORD:	3m [10'], TOP-FED
REGULATORY STANDARD:	RoHS COMPLIANT

**Notes:**  
This drawing and its specifications are the property of ENCONNEX and shall not be copied, reproduced, or used in whole or in part, as the basis for the manufacture or sale of items without written permission from ENCONNEX. This drawing is based upon the latest available information and is subject to change without notice.

<b>TOLERANCES</b> LINEAR (mm) X = ± 1 X.X = ± 0.5 X.XX = ± 0.30 X.XXX = ± 0.130 ANGULAR X = 1° .X = 0.5° .XX = 0.25°	<b>MATERIAL:</b>	 4670 AIRCENTER CIRCLE, RENO, NV 89502	<b>PART NUMBER:</b> ECX-
	<b>DESCRIPTION:</b>		<b>DESCRIPTION:</b>
	DEBUR AND BREAK SHARP EDGES/CORNERS AT 0.2mm MAX	DRAWN BY: WADE A CLARKE APPROVED BY: R. FAULKNER	ORG DATE: 2020-09-09 REV DATE: 2019-03-08
UNITS: mm [in]	INTERPRET TO ASME Y14.100	SIZE: B SCALE: 1 : 1	SHEET: 1/1 REV: A